MATERIAL	C40/50	XC2-XS1	Cl 0,10	D_{inf}8	D_{sup}12	SF2	SETTING TIME	Class 2	
MATERIAL (POURING IN SITU)		C40/50	XC2-XF1-XD1-XS1	Cl 0,20	D_{inf}8	D_{sup}14			
CONCRETE COVER (mm)	35	LAP LENGTH	According EC2, point 8.7.				ANCHORAGE LENGTH	30Ø	
DESIGN LIFE (years)	50	STRUCTURAL CLASS	S4				EXECUTION CLASS	Class 2	
STEEL REBARS	A500NR SD	STEEL MESH	A500ER				PRESTRESSED STEEL	Y1770C	
		PRE TENSION	1250MPa	According 5.10.2.1 NP-EN 1992-1-1_2010					

PLAN AT EL. 8,480 TOC
1:100

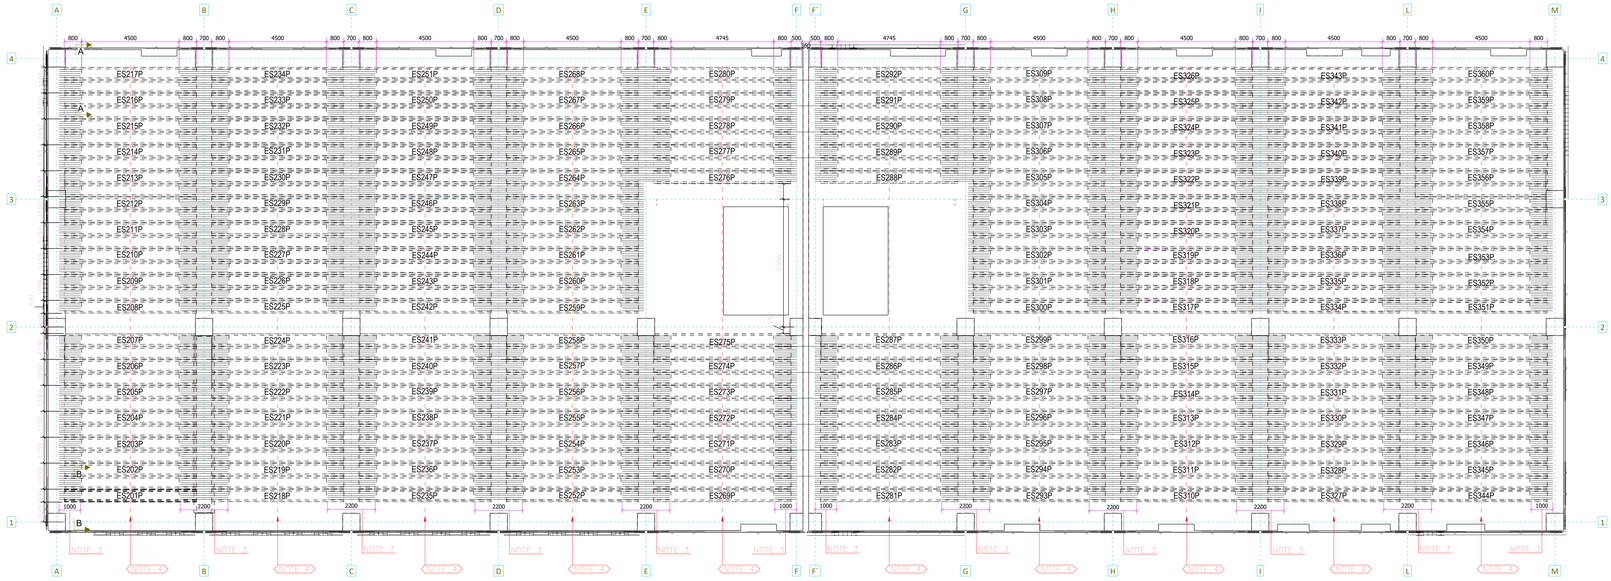

PLAN AT EL. 8,480 TOC
1:100

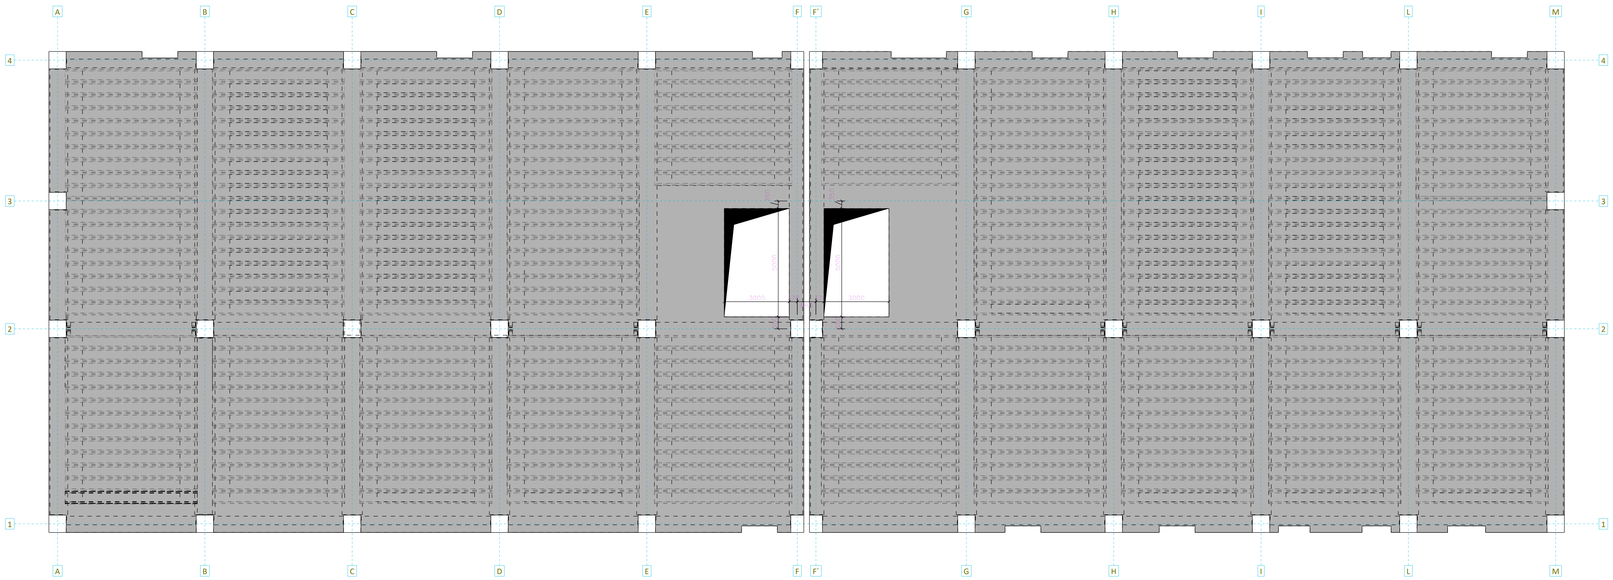

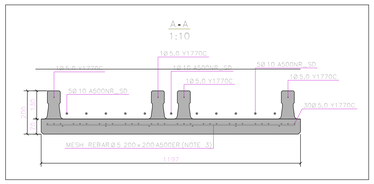

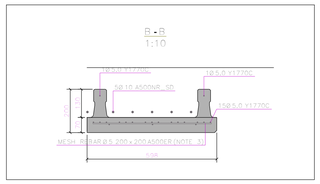

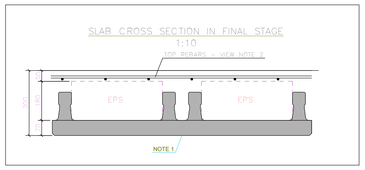



NOTE 1: AFTER ELEVATION MARK MIDDLE SECTION FOR HVAC FIXING SUPPORTS.

NOTE 2: TOP REBARS AS PER TCM DRAWING NO. 45-Q-45-000-8-08-75098

NOTE 3: BOTTOM REBARS FOR SHEAR - L=2,20M FOR CONTINUOUS SLABS AND L=1,00M FOR OTHER CASES

NOTE 4: PROVIDE PROP SUPPORT AT MIDSPAN OF PRECAST SLABS DURING INSTALLATION.

Tekla Structures